



中国认可
国际互认
检测
TESTING
CNAS L0128



W02214600092E

检测报告

Test Report

(Relatório de testes em laboratório)



HRp2oqL3

Name of Sample

PV module

Gegenstand der Prüfung

Type

SE5-72H-550M, SE4-72H-450M

Tipo de modulo

Applicant

SunEvo Solar Co., Ltd.

Requerente

Test Purpose

Entrusted Tests

Finalidade do teste

上海市质量监督检验技术研究院
Shanghai Institute of Quality Inspection and Technical Research



Shanghai Institute of Quality Inspection and Technical Research

Test Report

Report No. : W02214600092E

Page: 1 / 18

Name of Sample <i>Gegenstand der Prüfung</i>	PV module	Test Purpose <i>Finalidade do teste</i>	Entrusted Tests
Type <i>Tipo de módulo</i>	SE5-72H-550M, SE4-72H-450M	Trade Mark <i>Marca</i>	SUNEVO
Grade <i>Grau</i>	Qualified products		
Applicant <i>Recorrente</i>	SunEvo Solar Co., Ltd.		
Tested Company <i>Testado empresa</i>	/		
Producer <i>Produtor</i>	/		
Number of Client <i>Número de cliente</i>	6003092	Entrusting/Sampling Date <i>Data De entrega</i>	22nd Mar,2022
Reception Date <i>Data de recepção:</i>	22nd Mar,2022	Sampling Spot <i>Local de amostragem</i>	/
Sample Quantity <i>Quantidade de amostra</i>	4 pcs	Sum of Sample <i>Soma de amostra</i>	/
Date of Production <i>Data De produção</i>	/	Original Number <i>Número de serie</i>	/
Situation of Sample <i>Situação Da amostra</i>	Intact Sent by client		
Testing Place <i>Local de realização dos testes:</i>	No.900 Jiangyue Rd, Shanghai		
Test Standard <i>Identificação dos testes</i>	IEC 61215:2005 Crystalline Silicon Terrestrial Photovoltaic(PV) Modules-Design Qualification and Type Approval		
Date of Testing <i>Data do teste</i>	24th Mar,2022 to 25th Mar,2022		
Conclusion <i>Conclusão</i>	The test report only offers a single testing conclusion; See the details on the page of summary.		
Client's Message <i>Mensagem do cliente</i>	Add. <i>Endereço</i>	No. 398 Ganquan Road, Hefei, Anhui, China	
	Zip Code	/	Tel. /
Remarks <i>Observações</i>	The test report only offers the conclusions for the tested items according to the relevant testing standards which are not included the conclusions of the untested items or performances. The test report has two versions, one in English, the other in Portuguese. The English one is in priority. The test items are not accredited; they shall only be used for technical research, education or internal quality control purpose. The test report is for INMETRO testing.		



Approved by: 谢磊雷 主任

谢磊雷

Checked by:

陈苏声

Tested by:

马潇

Test Report

Report No. : W02214600092E

Shanghai Institute of Quality Inspection and Technical Research

Page: 2 / 18

Collection of The Test Results					
<i>Coleção de testes</i>					
No. <i>Número</i>	Test Items <i>Definição de funções</i>	Technical Requirements <i>Requisitos técnicos</i>	Test Results <i>Resultados de teste</i>	Judgements by Single Item <i>Juizos de valor por item único</i>	Remarks <i>Observações</i>
1	Visual inspection <i>Inspeção visual</i>	IEC 61215:2005 10.1	Page 4	Complies	/
2	Insulation test <i>Teste de isolamento de</i>	IEC 61215:2005 10.3	Page 5	Complies	/
3	Performance at STC <i>O desempenho Na STC de</i>	IEC 61215:2005 10.6	Page 6	Complies	/
4	Wet leakage current test <i>Teste de fuga de corrente molhada de</i>	IEC 61215:2005 10.15	Page 7	Complies	/
Supplementary information: none <i>Informação suplementar: nenhuma</i>					

Test Report

Report No. : W02214600092E

Shanghai Institute of Quality Inspection and Technical Research

Page: 3 / 18

Test item description <i>Teste item descrição</i>		
List of Test Samples: <i>Lista de amostras:</i>		
Sample # <i>Amostra</i>	Model <i>Modelo</i>	S/N
1.	SE5-72H-550M	SE00157222030400121
2.	SE5-72H-550M	SE00157222030400122
3.	SE4-72H-450M	SE00147222031000536
4.	SE4-72H-450M	SE00147222031000537
Abbreviations: <i>Abreviaturas:</i>		
Pmax – Maximum power <i>Pmax- Potência máxima</i>	STC – Standard Test Conditions <i>STC- Condições normais de ensaio</i>	Voc – Open Circuit Voltage <i>Voc –Circuito aberto de tensão</i>
Vmp – Maximum Power Voltage <i>Vmp –Potência máxima</i>	FF –Fill Factor <i>FF- Enches o Factor</i>	Imp – Maximum Power Current <i>Imp- Potência máxima actual</i>
Isc – Short Circuit Current	<i>Isc- Curto circuito atual</i>	
Possible test case verdicts: <i>Caso verdicts:</i>		
- test case does not apply to the test object N/A <i>O caso do teste não é aplicado ao teste object: N/A</i>		
- test object does meet the requirement..... P (Pass) <i>O teste object conhece a requisição.....: P (Pass)</i>		
- test object does not meet the requirement..... F (Fail) <i>- O teste object não conhece a requisição: F (Fail)</i>		
-test case provides measured values..... — <i>- O caso de ensaio é um valor medido.....: —</i>		
Supplementary information: none <i>Informação suplementar: nenhuma</i>		

Test Report

Report No. : W02214600092E

Shanghai Institute of Quality Inspection and Technical Research

Page: 5 / 18

10.3		Insulation test <i>Teste de isolamento</i>				P
Test date [DD/MM/YYYY] <i>Data de realização dos testes [DD/MM/AAAA]</i>		24/03/2022				—
Maximum system voltage [V_{DC}] <i>Voltagem máxima do sistema [V_{DC}]</i>		1500				—
High voltage applied [V_{DC}] <i>Alta tensão aplicada [V_{DC}]</i>		4000				—
Insulation resistance measured at [V_{DC}] <i>Valor da medição da resistência de isolamento [V_{DC}]</i>		1500				—
Sample # <i>Amostra #</i>	Area <i>Área</i>	Required <i>Valores-limite</i>	Measured <i>Medida</i>	Dielectric breakdown <i>Quebra dielétrica</i>		Result* <i>Resultado*</i>
	m ²	M Ω	M Ω	Yes (description) <i>Sim (descrição)</i>	No(description) <i>Não</i>	
1.	2.58	≥ 15.5	30910	/	No	P
2.	2.58	≥ 15.5	33500	/	No	P
3.	2.17	≥ 18.4	26700	/	No	P
4.	2.17	≥ 18.4	28020	/	No	P
*Supplementary information: Minimum requirement acc. to the standard is 40.0 M Ω *m ² . <i>*Informação suplementar: Os requisitos mínimos de acordo com a norma são 40.0 MΩ*m²</i>						

Test Report

Report No. : W02214600092E

Shanghai Institute of Quality Inspection and Technical Research

Page: 6 / 18

10.6		Performance at STC <i>O DESEMPENHO NA STC</i>					P ¹
Test date [DD/MM/YYYY] <i>Data de realização dos testes [DD/MM/AAAA]</i>		24/03/2022					—
Radiant Source <i>Radiante da fonte</i>		<input checked="" type="checkbox"/> Solar Simulator <i>Do simulador Solar</i>		<input type="checkbox"/> Natural Sunlight <i>Natural de luz do sol</i>		—	
Module temperature [°C] <i>Temperatura do módulo [°C]</i>		25.0±0.5					—
Irradiance [W/m ²] <i>Irradiação [W/m²]</i>		1000±10					—
Sample # <i>Amostra #</i>	Voc [V]	Vmp [V]	Isc [A]	Imp [A]	Pmax [W]	FF [%]	
1.	50.10	42.15	13.72	13.09	551.76	80.27	
2.	50.10	42.23	13.72	13.09	552.72	80.44	
3.	49.58	41.37	11.49	10.91	451.30	79.25	
4.	49.58	41.43	11.49	10.91	452.07	79.39	
<p>Supplementary information: <i>Informação suplementar:</i></p> <p>Measurements were performed at standard test conditions (STC) with a flash light solar simulator class AAA acc. to IEC 61215:2005. <i>As medições foram realizadas em condições padrão (STC) com um simulador solar de flash (flasher) classe AAA de acordo com a IEC 61215:2005.</i></p> <p>*measured graphs see IV curves in Photos of modules. <i>*para os valores medidos ver curvas IV no Fotos dos módulos.</i></p> <p>†The discrepancy between the labelled power value and the measured value shall not exceed the limit of -5%~10%. <i>†A discrepância entre o valor de potência indicada no rotulo e o valor medido não deve exceder o limite de -5%~10%.</i></p> <p>The measuring uncertainty of Pmax is ≤±2.1%. <i>A incerteza de medição para Pmax é ≤±2.1%.</i></p> <p>The measuring uncertainty of Isc is ≤±2.0%. <i>A incerteza de medição para Isc é ≤±2.0%.</i></p> <p>The measuring uncertainty of Voc is ≤±0.8%. <i>A incerteza de medição para Voc é ≤±0.8%.</i></p> <p>Measuring uncertainty includes spectral mismatch error. <i>A incerteza de medição inclui os erros por desvios no espectro.</i></p>							

Test Report

Report No. : W02214600092E

Shanghai Institute of Quality Inspection and Technical Research

Page: 7 / 18

10.15	Wet leakage current test <i>Teste de fuga de corrente molhada</i>			P
Test date [DD/MM/YYYY] <i>Data de realização dos testes [DD/MM/AAAA]:</i>	24/03/2022			—
Insulation resistance measured at [V_{DC}] <i>Valor da medição da resistência de isolamento [V_{DC}]</i>	1500			—
Solution temperature [$^{\circ}C$] <i>Temperatura da solução [$^{\circ}C$]</i>	22±3	21.5	—	
Solution resistivity [Ω cm] <i>Resistencia da solução [Ω cm]</i>	≤ 3500	1822	—	
Sample # <i>Amostra #</i>	Area <i>Área</i> [m ²]	Required <i>Valores-limite</i> [M Ω]	Measured <i>Medida</i> [M Ω]	Result* <i>Resultado*</i>
1.	2.58	≥ 15.5	5227	P
2.	2.58	≥ 15.5	5590	P
3.	2.17	≥ 18.4	4739	P
4.	2.17	≥ 18.4	4581	P
*Supplementary information: Minimum requirement acc. to the standard is 40.0 M Ω *m ² . <i>*Informação suplementar: Os requisitos mínimos de acordo com a norma são 40.0 MΩ*m²</i>				

Test Report

Report No. : W02214600092E

Shanghai Institute of Quality Inspection and Technical Research

Page: 8 / 18

Photos of modules

Fotos dos módulos

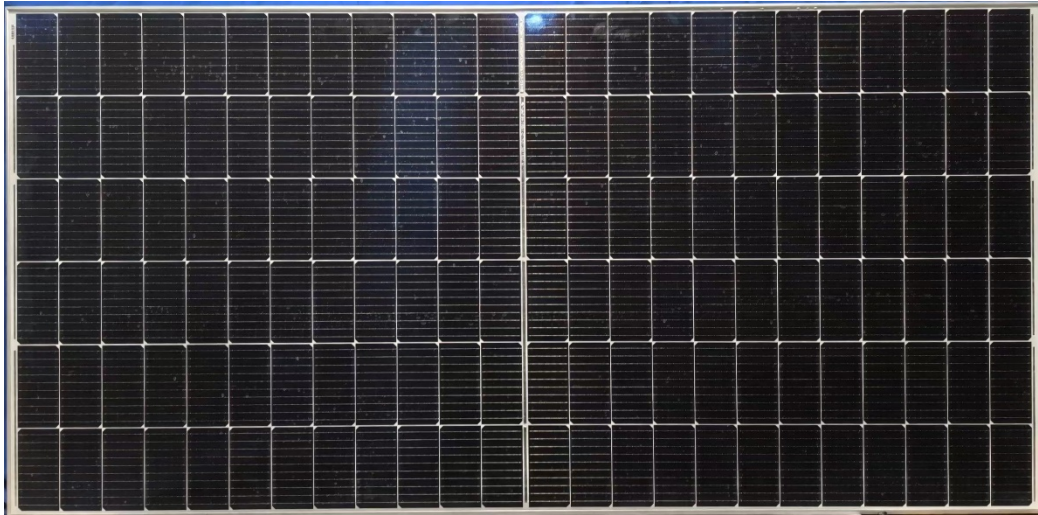


Fig. 1: Front view of module type SE5-72H-550M

Fig. 1: Vista frontal do tipo de módulo SE5-72H-550M

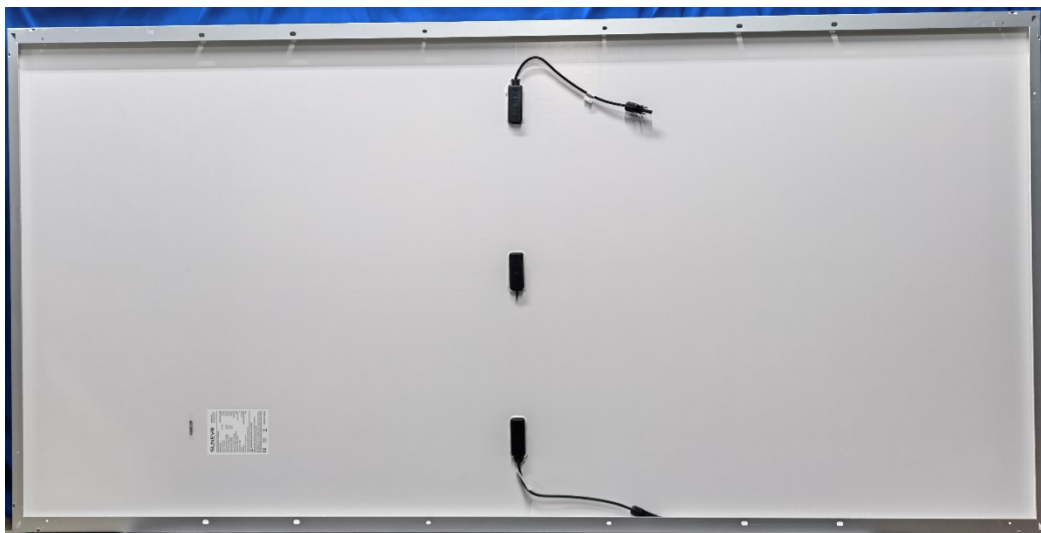


Fig. 2: Rear view of module type SE5-72H-550M

Fig. 2: Vista da parte traseira do tipo de módulo SE5-72H-550M

Test Report

Report No. : W02214600092E

Shanghai Institute of Quality Inspection and Technical Research

Page: 9 / 18

Photos of modules

Fotos dos módulos



Fig. 3: View of junction box of module type SE5-72H-550M

Fig. 3: Vista detalhada da caixa de junção do tipo de módulo SE5-72H-550M

SUNEVO

Leading the energy evolution


SunEvo Solar
Tel: 0086 551 6262 4885
Email: info@sunevo.com
Web: www.sunevo.com


PHOTOVOLTAIC MODULE


Module Type	SE5-72H-550M
Maximum Power (Pmax)	550W
Power Tolerance	0-+3%
Maximum Power Voltage (Vmp)	42.10V
Maximum Power Current (Imp)	12.06A
Open Circuit Voltage (Voc)	50.10V
Short Circuit Current (Isc)	13.90A
Maximum System Voltage	1500VDC
Maximum Series Fuse Rating	25A
Operating Temperature	-40°C-+85°C
Application Class	A
Weight	28.4kg
Dimension	2279x1134x35mm
Pmax/Voc/Isc Tolerance	±3%
Test at STC: 1000W/m ² , AM1.5, 25°C	

⚠ WARNING-ELECTRIC HAZARD

Only qualified personnel should install or perform maintenance work on these modules
Be aware of high DC voltage when connecting modules
Do not damage or scratch the rear surface of the module







MADE IN CHINA

Fig. 4: View of type label of module type SE5-72H-550M

Fig.4: Vista detalhada da placa de características do tipo de módulo SE5-72H-550M

Test Report

Report No. : W02214600092E

Shanghai Institute of Quality Inspection and Technical Research

Page: 10 / 18

Photos of modules

Fotos dos módulos



Fig. 5: Front view of module type SE4-72H-450M

Fig. 5: Vista frontal do tipo de módulo SE4-72H-450M



Fig. 6: Rear view of module type SE4-72H-450M

Fig. 6: Vista da parte traseira do tipo de módulo SE4-72H-450M

Test Report

Report No. : W02214600092E

Shanghai Institute of Quality Inspection and Technical Research

Page: 11 / 18

Photos of modules

Fotos dos módulos



Fig. 7: View of junction box of module type SE4-72H-450M

Fig. 7: Vista detalhada da caixa de junção do tipo de módulo SE4-72H-450M

SUNEVO

Leading the energy evolution



SunEvo Solar
Tel: 0086 551 6262 4885
Email: info@sunevo.com
Web: www.sunevo.com

PHOTOVOLTAIC MODULE

Module Type	SE4-72H-450M
Maximum Power (Pmax)	450W
Power Tolerance	0-+3%
Maximum Power Voltage (Vmp)	41.50V
Maximum Power Current (Imp)	10.85A
Open Circuit Voltage (Voc)	49.30V
Short Circuit Current (Isc)	11.60A
Maximum System Voltage	1500VDC
Maximum Series Fuse Rating	20A
Operating Temperature	-40°C-+85°C
Application Class	A
Weight	24.00kg
Dimension	2094x1038x35mm
Pmax/Voc/Isc Tolerance	±3%
Test at STC: 1000W/m ² , AM1.5, 25°C	

⚠ WARNING-ELECTRIC HAZARD

Only qualified personnel should install or perform maintenance work on these modules
Be aware of high DC voltage when connecting modules
Do not damage or scratch the rear surface of the module




**MADE IN CHINA**

Fig. 8: View of type label of module type SE4-72H-450M

Fig.8: Vista detalhada da placa de características do tipo de módulo SE4-72H-450M

Test Report

Report No. : W02214600092E

Shanghai Institute of Quality Inspection and Technical Research

Page: 12 / 18

Electroluminescence images

Imagens de eletroluminescência

Analysis of electroluminescence images with respect to micro cracks (EL photos)

Análise de imagens de eletroluminescência referente a Microfissuras

Test date [DD/MM/YYYY] <i>Data de realização dos testes [DD/MM/AAAA]</i>		24/03/2022
Sample # <i>Amostra #</i>	Reverse current applied [A] <i>Corrente inversa aplicada [A]</i>	Attributes <i>Atributos</i>
1.	Isc ± 5%	N/A
2.	Isc ± 5%	N/A
3.	Isc ± 5%	N/A
4.	Isc ± 5%	N/A
Supplementary information: none <i>Informação suplementar: nenhuma</i>		

Test Report

Report No. : W02214600092E

Shanghai Institute of Quality Inspection and Technical Research

Page: 13 / 18

Energy efficiency class

Classe de eficiência energética

Sample # <i>Amostra #</i>	Module width <i>Largura do módulo</i> [mm]	Module length <i>Comprimento do módulo</i> [mm]	Module area <i>área modulo</i> [m ²]	Module power <i>potência módulo</i> [W]	Module efficiency <i>eficiência do módulo</i> [%]	Energy efficiency class <i>Classe de eficiência energética</i>
1.	1134	2279	2.58	550	21.3	A
2.	1134	2279	2.58	550	21.3	A
3.	1038	2094	2.17	450	20.7	A
4.	1038	2094	2.17	450	20.7	A

Supplementary information: none
Informação suplementar: nenhuma

Energy efficiency classes Classe de Eficiência Energética
A > 13.5%
13% < B ≤ 13.5%
12% < C ≤ 13%
11% < D ≤ 12%
E < 11%

Test Report

Report No. : W02214600092E

Shanghai Institute of Quality Inspection and Technical Research

Page: 14 / 18

Photos of modules

Fotos dos módulos

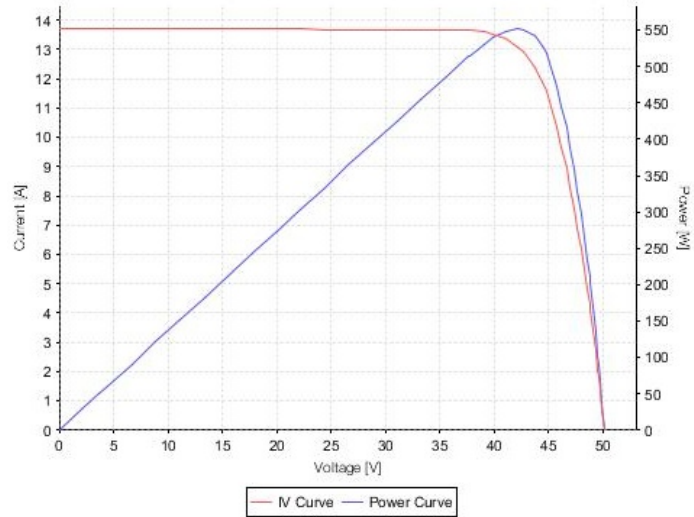


Fig. 9 IV curve of module No.1 Serial number: SE00157222030400121

Fig. 9 IV curva de módulo No.1 Número de série: SE00157222030400121

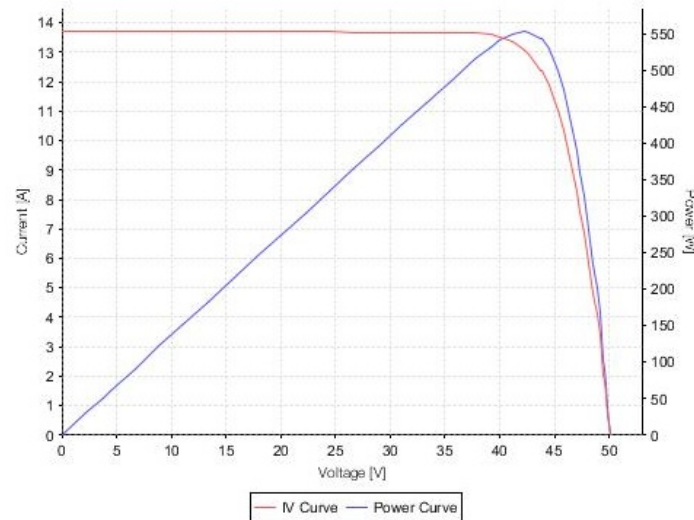


Fig. 10 IV curve of module No.2 Serial number: SE00157222030400122

Fig. 10 IV curva de módulo No.2 Número de série: SE00157222030400122

Test Report

Report No. : W02214600092E

Shanghai Institute of Quality Inspection and Technical Research

Page: 15 / 18

Photos of modules

Fotos dos módulos

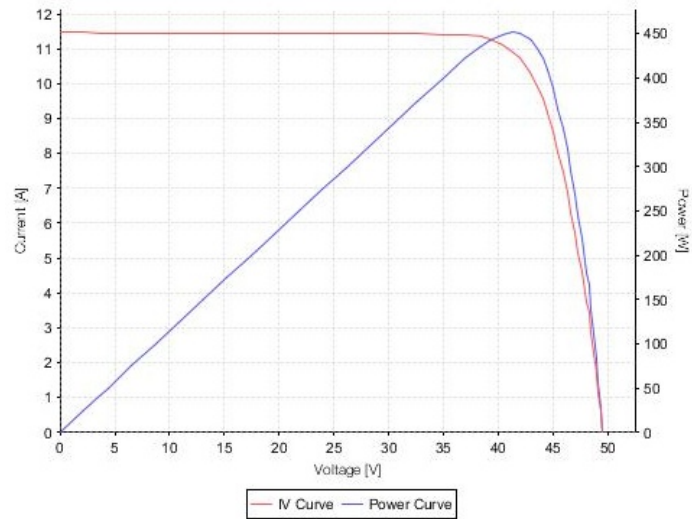


Fig. 11 IV curve of module No.3 Serial number: SE00147222031000536

Fig. 11 IV curva de módulo No.3 Número de série: SE00147222031000536

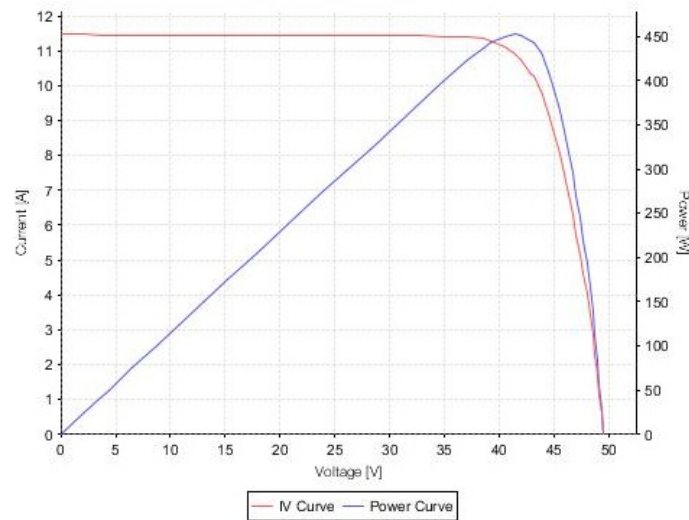


Fig. 12 IV curve of module No.4 Serial number: SE00147222031000537

Fig. 12 IV curva de módulo No.4 Número de série: SE00147222031000537

Test Report

Report No. : W02214600092E

Shanghai Institute of Quality Inspection and Technical Research

Page: 16 / 18

EL images

Imagens de electroluminescência

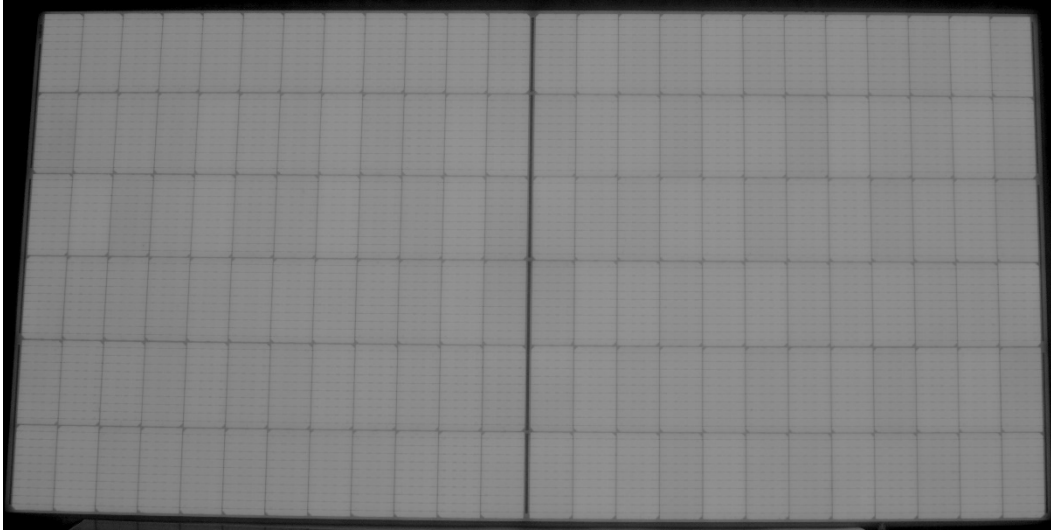


Fig. 13 EL photo of module No.1 Serial number: SE00157222030400121

Fig. 13 EL fotografia de módulo No.1 Número de série: SE00157222030400121

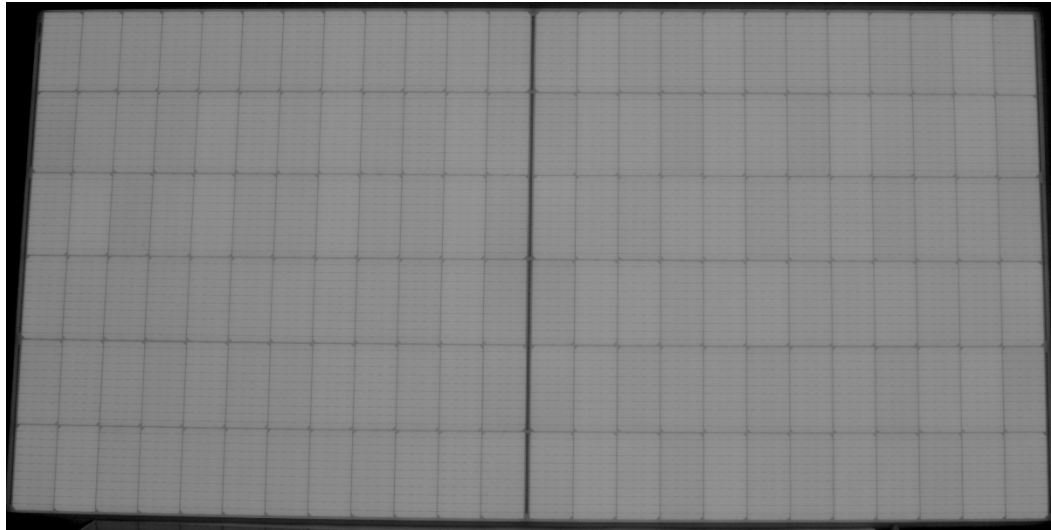


Fig. 14 EL photo of module No.2 Serial number: SE00157222030400122

Fig. 14 EL fotografia de módulo No.2 Número de série: SE00157222030400122

Test Report

Report No. : W02214600092E

Shanghai Institute of Quality Inspection and Technical Research

Page: 17 / 18

EL images

Imagens de electroluminescência

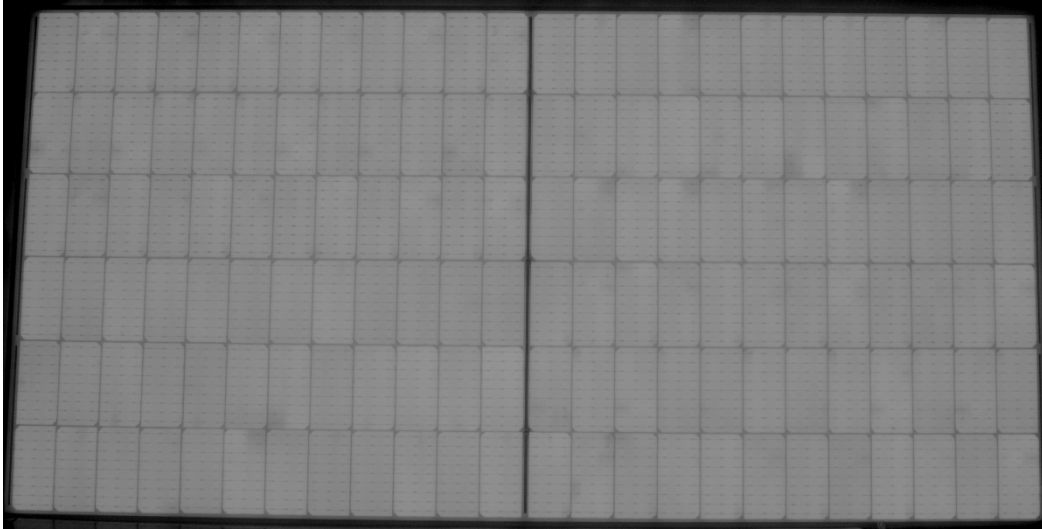


Fig. 15 EL photo of module No.3 Serial number: SE00147222031000536

Fig. 15 EL fotografia de módulo No.3 Número de série: SE00147222031000536

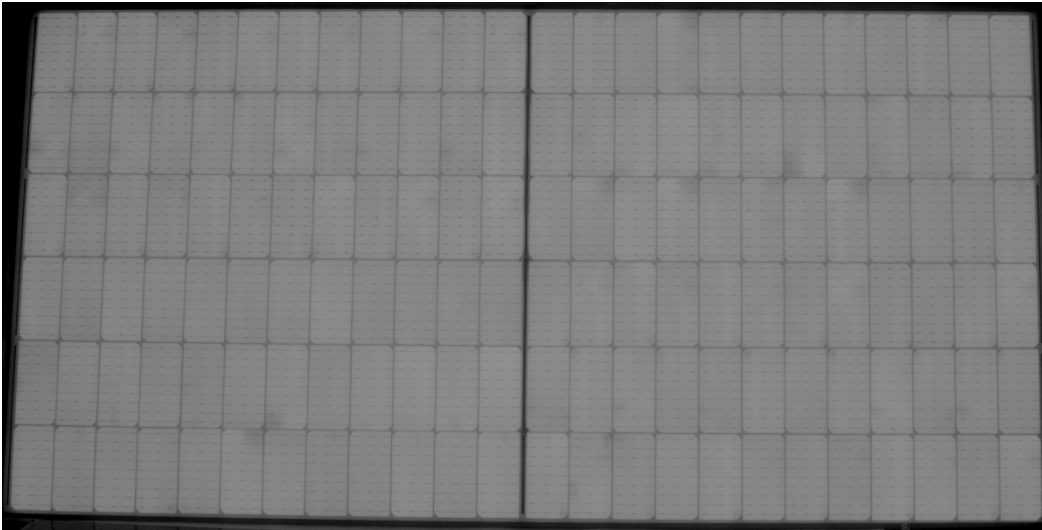


Fig. 16 EL photo of module No.4 Serial number: SE00147222031000537

Fig. 16 EL fotografia de módulo No.2 Número de série: SE00147222031000537

Test Report

Report No. : W02214600092E

Shanghai Institute of Quality Inspection and Technical Research

Page: 18 / 18

List of measurement equipment

Clause	Measurement / testing	Testing / measuring equipment / material used, (Equipment ID)	Range used	Last Calibration date	Calibration due date
10.1	Visual inspection	Digital illuminometer DZ-B-A1-0200	0~2000lux	2022-02-25	2023-02-24
		Band tape DZ-B-A1-0014	3.5m	2021-09-02	2024-09-01
10.3	Insulation test	Insulation tester DZ-A-A1-0258	0~6kV, 1~50GΩ	2021-05-06	2022-05-05
10.6	Performance at STC	Pulse solar simulator DZ-A-A2-0156	200~1200W/m ²	2021-09-17	2022-09-16
		Reference module DZ-B-A1-0176	c-Si	2022-03-04	2023-03-03
10.15	Wet leakage current	Insulation tester DZ-A-A1-0258	0~6kV, 1~50GΩ	2021-05-06	2022-05-05
		Conductivity meter DZ-B-A2-0055	0μS/cm~100mS/ cm, 0.0~60.0 °C	2021-05-27	2022-05-26
/	EL image	EL camera DZ-A-A1-0274	/	2019-08-27	2029-08-26
		Power supply DZ-A-A1-0009	160V 50A	2021-12-29	2022-12-28

The below is blank.

注 意 事 项

Notices

- 1、报告无“检验检测专用章”或检测单位公章无效。

The report is valid with the "special seal for inspection and testing" or the official seal of SQI.

- 2、不得部分复制报告，复制报告须加盖“检验检测专用章”或检测单位公章，否则无效。

The report shall not be reproduced except in full. The copied report is valid with the "special seal for inspection and testing" or the official seal of SQI.

- 3、报告无主检/编制、审核、批准人签名无效。

The report is valid with signature of major inspector, reviewer and approver.

- 4、报告涂改无效。

The report is invalid with any alteration or falsification.

授权国家质检中心名称

National Center of Quality Inspection and Testing

- 1、国家日用消费品质量检验检测中心

National Center of Quality Inspection and Testing on Consumer Goods

- 2、国家家具质量检验检测中心

National Center of Quality Inspection and Testing on Furniture

- 3、国家建筑材料及装饰装修材料质量检验检测中心

National Center of Quality Inspection and Testing on Building and Decoration Materials

- 4、国家智能电网分布式电源装备质量检验检测中心（上海）

National Center of Quality Inspection and Testing on Distributed Power Equipment in Smart Grid (Shanghai)

- 5、国家电器能效与安全质量检验检测中心

National Center of Quality Inspection and Testing on Energy Efficiency and Safety of Electrical Appliance

- 6、国家食品质量检验检测中心（上海）

National Center of Quality Inspection and Testing on Food Products (Shanghai)

- 7、国家保洁产品质量检验检测中心

National Center of Quality Inspection and Testing on Cosmetics and Cleaning Products

- 8、国家电光源质量检验检测中心（上海）

National Center of Inspection and Testing on Electric Light Source Quality (Shanghai)

- 9、国家灯具质量检验检测中心

China National Lighting Fitting Quality Inspection and Testing Centre (CLTC)

声 明

Statement

- 1、本质检机构保证检测的科学性、公正性和准确性，对检测的数据、结果负责，并对客户所提供的样品和技术资料保密。

SQI pledges to conduct scientific, impartial and accurate testing, undertakes the liability of testing data and results, and protects the confidentiality of client(s)' sample(s) and technical information.

- 2、对送样委托检测报告若有异议，应于报告收到之日起十五日内向本质检机构提出，逾期不予受理。

Any objection to the test report of delivered samples shall be submitted to SQI within 15 days from the date of receiving the report; overdue submission will not be accepted.

- 3、对于非本质检机构实施抽样的检测报告，检测结果仅适用于客户提供的样品。

For the test report not sampled by SQI, the test results hereon refer only to the sample(s) provided by the client.

- 4、未经本质检机构同意，委托人不得擅自使用检测数据、结果进行不当宣传。

Without prior approval of SQI, any client shall not use the testing data and results for improper publicity.

- 5、本质检机构在资质认定证书确定的能力范围内，对社会出具具有证明作用数据、结果时，应当标注检验检测机构资质认定标志，并加盖检验检测专用章。在资质认定证书确定的能力范围外，出具的检验检测报告或者证书上不得标注检验检测机构资质认定标志，该数据、结果对社会不具有证明作用。

Within the capacity scopes of Qualification Accreditation Certificates, SQI shall issue data and results with proving effect to the society with the symbol of China Inspection Body and Laboratory Mandatory Approval (CMA) and the special seal for inspection and testing of SQI. Beyond the capacity scopes of Qualification Accreditation Certificates, SQI shall not issue test reports or certificates with the symbol of China Inspection Body and Laboratory Mandatory Approval (CMA), and the data and results thereon have no proving effect to the society.

上海市质量监督检验技术研究院所属单位一览表

List of Subordinate Units of Shanghai Institute Of Quality Inspection and Technical Research (SQI)

- 食品化学产品质量检验所(代码 SP) / 国家食品质量检验检测中心(上海) / 国家保洁产品质量检验检测中心 / 上海市食品质量监督检验站**
Institute of Quality Inspection of Food and Chemicals (SQI_SP) / National Center of Quality Inspection and Testing on Food Products (Shanghai) / National Center of Quality Inspection and Testing on Cosmetics and Cleaning Products / Shanghai Municipal Station of Quality Supervision and Inspection of Food Products
地址: 上海市徐汇区苍梧路 381 号 邮编: 200233
电话: 021-54263362 传真: 021-54265730
地址: 上海市奉贤区平庄西路 3086 号 (日化产品) 邮编: 201499
电话: 021-57493107 传真: 021-57493162
E-mail: shihuas@sqi.org.cn
Address: No.381, Cangwu Rd., Xuhui District, Shanghai Post: 200233
Tel: 021-54263362 Fax: 021-54265730
Address: No.3086, West Pingzhuang Rd., Fengxian District, Shanghai (Daily Chemical Products) Post: 201499
Tel: 021-57493107 Fax: 021-57493162
E-mail: shihuas@sqi.org.cn
- 上海时代之光照明电器检测有限公司(代码 ZM) / 国家电光源质量检验检测中心(上海) / 国家灯具质量检验检测中心 / 国家轻工业灯具质量监督检测中心 / 上海市照明产品质量监督检验站**
Shanghai Alpha Lighting Equipment Testing Ltd. (SQI_ZM) / National Center of Inspection and Testing on Electric Light Source Quality (Shanghai) / China National Lighting Fitting Quality Inspection and Testing Centre (CLTC) / National Center for Quality Supervision and Inspection of Light Industrial Luminaires / Shanghai Municipal Station of Quality Supervision and Test on Lighting Products
地址: 上海市闵行区江月路 900 号 2 号楼 邮编: 201114
电话: 021-54336162; 54336173; 54336181; 54336227 传真: 021-54337200
E-mail: salt@sqi.org.cn; salt@salmet.com.cn; sdzg@sqi.org.cn
Address: 2nd Building, No.900, Jiangyue Rd., Minhang District, Shanghai Post: 201114
Tel: 021-54336162, 54336173, 54336181, 54336227 Fax: 021-54337200
E-mail: salt@sqi.org.cn, salt@salmet.com.cn, sdzg@sqi.org.cn
- 机电产品质量检验所(代码 JD) / 上海市机电产品质量监督检验站**
Institute of Quality Inspection of Mechanical and Electronic Products (SQI_JD) / Shanghai Municipal Station of Quality Supervision and Inspection of Mechanical and Electronic Products
地址: 上海市静安区万荣路 918 号 邮编: 200072
电话: 021-56035307; 56652534 传真: 021-56652624
E-mail: jds@sqi.org.cn
Address: No.918, Wanrong Rd., Jing'an District, Shanghai Post: 200072
Tel: 021-56035307, 56652534 Fax: 021-56652624
E-mail: jds@sqi.org.cn
- 轻工与化工产品质量监督检验所(代码 QG、HG) / 国家日用消费品质量监督检验中心 / 上海市轻工产品质量监督检验站 / 上海市化工产品质量监督检验站**
Institute of Quality Inspection of Light Industrial Products and Chemical Products (SQI_QG/HG) / National Center of Quality Inspection and Testing on Consumer Goods / Shanghai Municipal Station of Quality Supervision and Inspection of Light Industrial Products / Shanghai Municipal Station of Quality Supervision and Inspection of Chemical Products
地址: 上海市闵行区江月路 900 号 3 号楼 邮编: 201114
地址: 上海市奉贤区平庄西路 3086 号 邮编: 201499
电话: 021-54336172; 54336175; 54338258 传真: 021-54336175
E-mail: qgs@sqi.org.cn; qinggong@sqi.org.cn
Address: 3rd Building, No.900, Jiangyue Rd., Minhang District, Shanghai Post: 201114
Address: No.3086, West Pingzhuang Rd., Fengxian District, Shanghai Post: 201499
Tel: 021-54336172, 54336175, 54338258 Fax: 021-54336175
E-mail: qgs@sqi.org.cn, qinggong@sqi.org.cn
- 建材家居装饰装修质量监督检验所(代码 JC) / 国家家具质量检验检测中心 / 国家轻工业家具质量监督检测中心 / 国家轻工业建筑五金质量监督检测中心 / 国家建筑材料及装饰装修材料质量监督检验检测中心 / 上海市建筑材料及装饰装修材料质量监督检验站 / 上海市室内装饰装修质量监督检验站**
Institute of Quality Inspection of Building Materials and Decoration Materials (SQI_JC) / National Center of Quality Inspection and Testing on Furniture / National Center for Quality Supervision and Inspection of Light Industrial Furniture / National Center for Quality Supervision and Inspection of Light Industrial Building Hardware / National Center of Quality Inspection and Testing on Building and Decoration Materials / Shanghai Municipal Station of Quality Supervision and Inspection of Building Materials and Decoration Materials / Shanghai Municipal Station of Quality Supervision and Inspection of Interior Decoration
地址: 上海市闵行区江月路 900 号 5 号楼 邮编: 201114
电话: 021-54336170; 54336225 传真: 021-54336170
地址: 上海市奉贤区平庄西路 3086 号 邮编: 201499
电话: 021-57493115 传真: 021-57493162
E-mail: jcs@sqi.com.cn; jiancai@sqi.org.cn
Address: 5th Building, No.900, Jiangyue Rd., Minhang District, Shanghai Post: 201114
Tel: 021-54336170, 54336225 Fax: 021-54336170
Address: No.3086, West Pingzhuang Rd., Fengxian District, Shanghai Post: 201499
Tel: 021-57493115 Fax: 021-57493162
E-mail: jcs@sqi.com.cn, jiancai@sqi.org.cn
- 电子电器家用电器质量监督检验所(代码 DZ、DQ) / 国家电器能效与安全质量检验检测中心 / 国家智能电网分布式电源装备质量检验检测中心(上海) / 上海市电子电器家用电器质量监督检验站**
Institute of Quality Inspection of Electronics and Household Appliances (SQI_DZ/DQ) / National Center of Quality Inspection and Testing on Energy Efficiency and Safety of Electrical Appliance / National Center of Quality Inspection and Testing on Distributed Power Equipment in Smart Grid (Shanghai) / Shanghai Municipal Station of Quality Supervision and Inspection of Electronics and Household Appliances
地址: 上海市闵行区江月路 900 号 4 号楼 邮编: 201114
电话: 021-54336322; 64336605 传真: 021-64313348
E-mail: dzs@sqi.org.cn
Address: 4th Building, No.900, Jiangyue Rd., Minhang District, Shanghai Post: 201114
Tel: 021-54336322, 64336605 Fax: 021-64313348
E-mail: dzs@sqi.org.cn
地址: 上海市徐汇区苍梧路 381 号 邮编: 200233
电话: 021-54263097; 64336605 传真: 021-64850806
E-mail: dqqs@sqi.org.cn
Address: No.381, Cangwu Rd., Xuhui District, Shanghai Post: 200233
Tel: 021-54263097, 64336605 Fax: 021-64850806
E-mail: dqqs@sqi.org.cn
- 计量检测所(代码 JL)**
Institute of Metrology Inspection (SQI_JL)
地址: 上海市闵行区江月路 900 号 邮编: 201114
电话: 021-54336149; 54336148 传真: 021-62892960
地址: 上海市徐汇区永嘉路 627 号 邮编: 200031
电话: 021-64372125 传真: 021-64372135
E-mail: jls@sqi.org.cn
Address: No.900, Jiangyue Rd., Minhang District, Shanghai Post: 201114
Tel: 021-54336149, 54336148 Post: 200031
Tel: 021-64372125 Fax: 021-64372135
E-mail: jls@sqi.org.cn
- 纤维检验所(代码 XW) / 国家日用消费品质量监督检验检测中心 / 上海市纤维纤维质量监督检验站**
Institute of Fiber Inspection (SQI_XW) / National Center of Quality Inspection and Testing on Consumer Goods / Shanghai Municipal Station of Quality Supervision and Inspection of Textile and Fiber
地址: 上海市长乐路 1228 号 邮编: 200040
电话: 021-62495465 传真: 021-62481025
E-mail: xws@sqi.org.cn
Address: No.1228, Changle Rd., Shanghai Post: 200040
Tel: 021-62495465 Fax: 021-62481025
E-mail: xws@sqi.org.cn